


PLAN

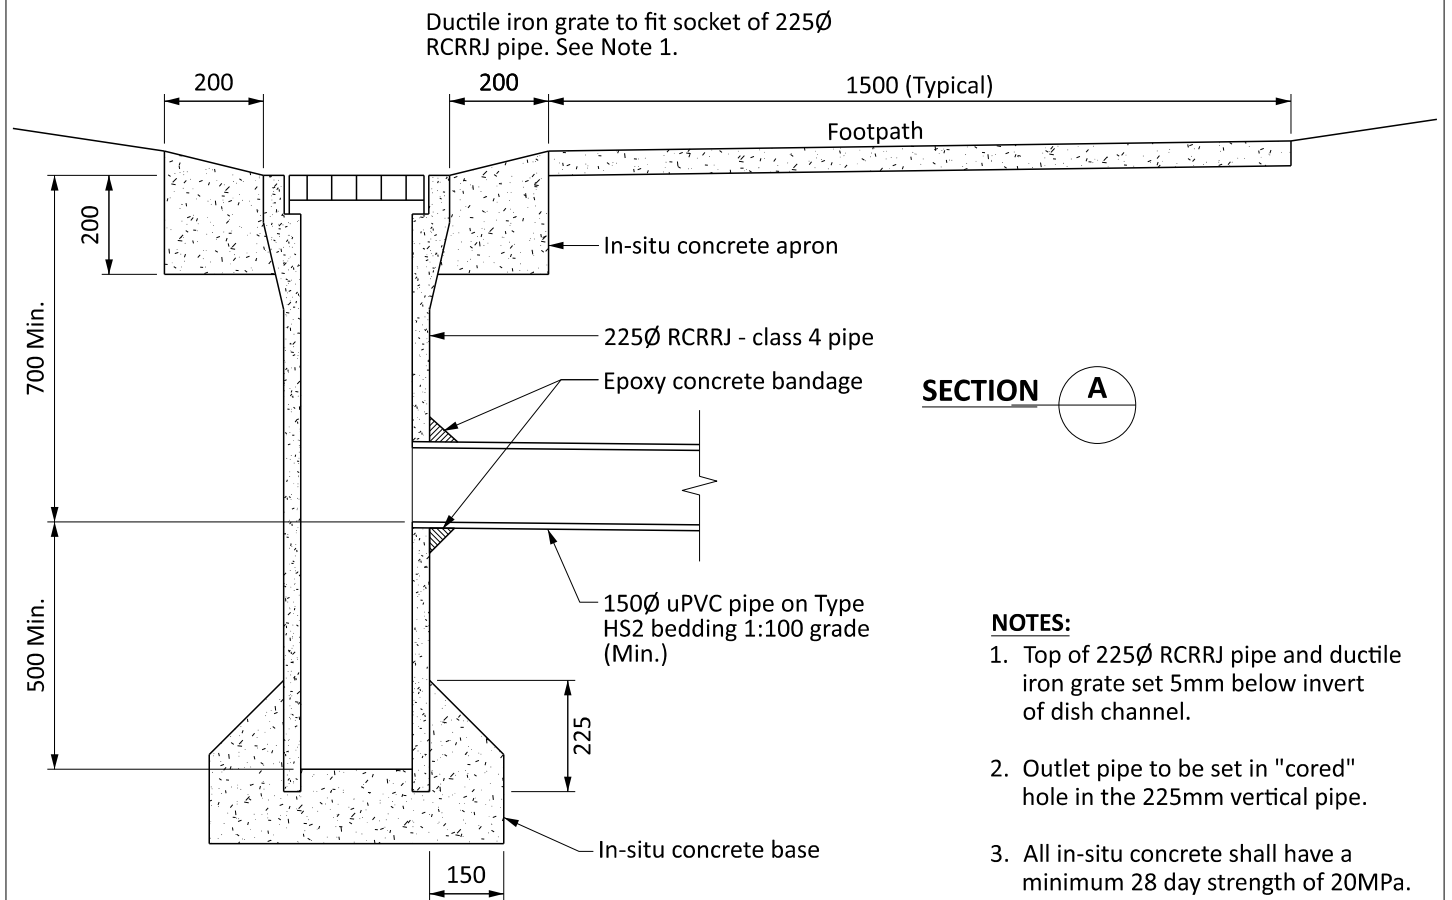

SECTION A

- NOTES:**
1. Top of 225Ø RCRRJ pipe and ductile iron grate set 5mm below invert of dish channel.
 2. Outlet pipe to be set in "cored" hole in the 225mm vertical pipe.
 3. All in-situ concrete shall have a minimum 28 day strength of 20MPa.