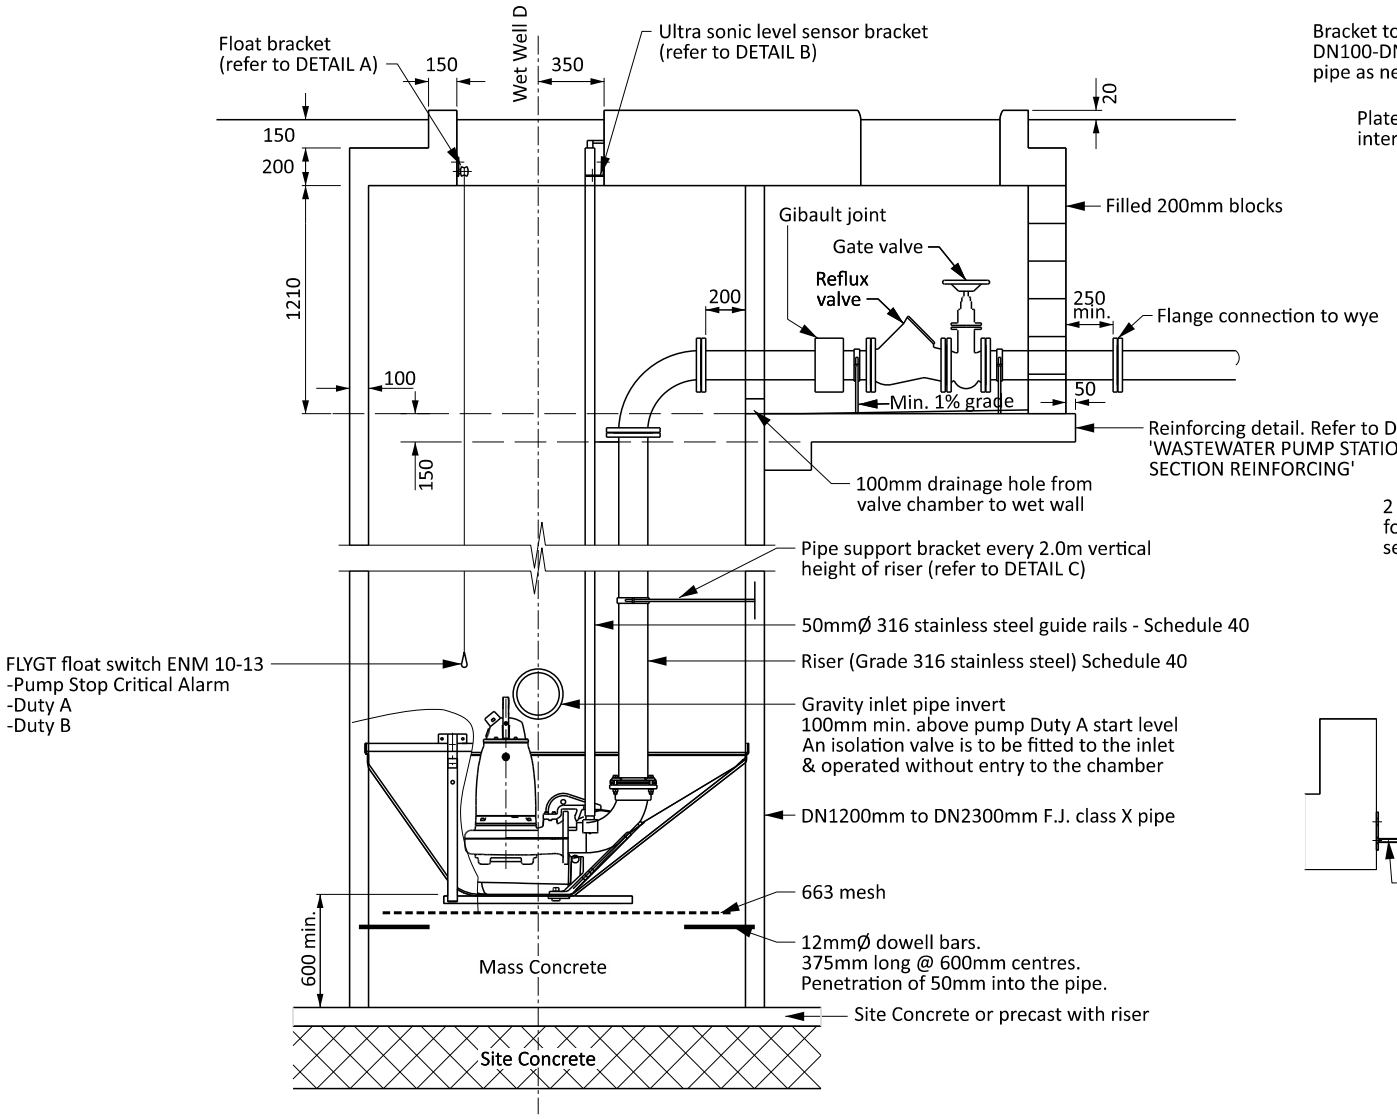

SECTIONAL ELEVATION

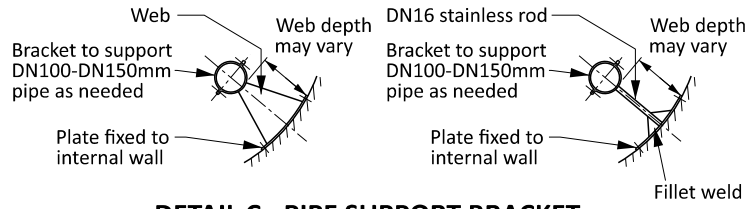

DETAIL C - PIPE SUPPORT BRACKET

Construct from 5mm 316 stainless steel

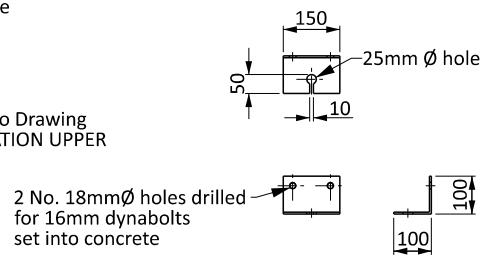

DETAIL B - ULTRASONIC SENSOR BRACKET

Construct from 100 x 100 x 6mm E.A. 316 stainless steel

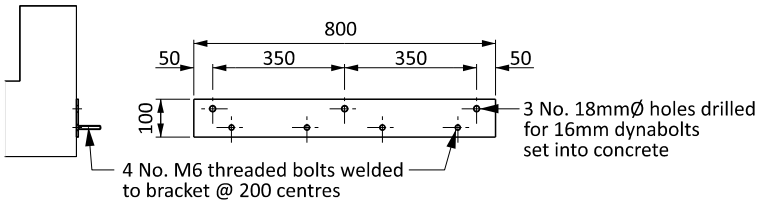

DETAIL A - FLOAT BRACKET

Construct from 5mm 316 stainless steel

NOTES:

1. Valve chamber sized to suit valves.
2. Refer to Drawing 'WASTEWATER PUMP STATION UPPER SECTION REINFORCING' for steel reinforcing details.

CO-LAB BETTER TOGETHER

WASTEWATER PUMP STATION CROSS SECTION