



SECTIONAL PLAN

NOTES:

1. Control cabinet plinth is to be constructed as shown on Drawing 'CONTROL CABINET PLINTH & SPS FLOW METER'.
2. Covers to openings refer Drawings 'WASTEWATER PUMP STATION LID DETAILS' and 'WET WELL SECONDARY LIDS'

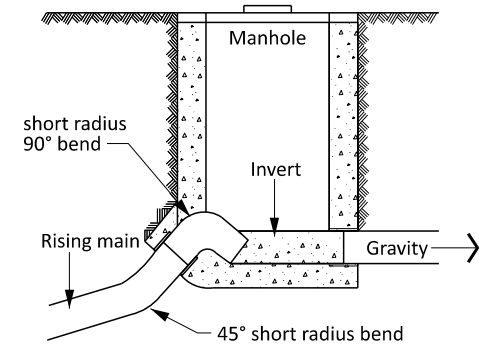

DETAIL A - ENTRY INTO RECEIVING MANHOLE

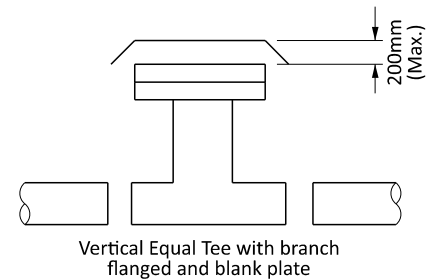

DETAIL B - EMERGENCY DISCHARGE MANHOLE

Emergency Discharge Manhole DN1050 (See Detail)
 Only on pump stations with PWWF over 20l/s downstream of flow meter.
 See Drawing 'WASTEWATER PUMP STATION STORAGE PLAN' for location